

WEEKLY DECLARATION FOR KERR & PHILPOTT
WILMINGTON DISTRICT CORPS OF ENGINEERS
CESAW-TS-EC, WATER MANAGEMENT

COMPUTED BY: ash 21-Jun-17
CHECKED BY: may 21-Jun-17

PERIOD: 24-Jun-17 thru 30-Jun-17

	KERR	PHILPOTT
TOTAL WEEKLY OUTFLOW (CFS-DAYS)	98000	1050
EQUIVALENT 7-DAY MEAN DAILY OUTFLOW (CFS)	14000	
TOTAL WEEKLY INFLOW (CFS-DAYS)	50000	1400
FORECASTED STARTING ELEV. (FT,MSL)	303.02	974.36
FORECASTED ENDING ELEV.(FT,MSL)	301.18	974.60
ENDING GUIDE CURVE ELEV.(FT,MSL)	301.35	973.50

ENERGY DECLARATION (ENERGY AMOUNTS ARE IN MWH)


FIRM	2875	300
SECONDARY	13385	0
FISH AUGMENTATION	0	0
TRANSFER	300	-300
TOTAL	16560	0
WATER EQUIVALENCY (ACRE-FEET)	196000	XXXXX

KERR-Dominion		PHILPOTT-Dominion	
CAP.	0 MW		MWH
ENER.	1900 MWH	ENER.	300 MWH
KERR-Progress		PHILPOTT-AEP	
CAP.	0 MW	CAP.	MW
ENER.	975 MWH	ENER.	MWH
TOTAL KERR CAP.	267 MW	TOTAL PHIL. CAP.	0 MW
TOTAL MIN KERR ENER.	2875 MWH	TOTAL MIN PHIL. ENER.	300 MWH

REMARKS:

1. Philpott capacity: 0 MW; complete plant outage since 29-Mar-2016 (return to service date unknown).
 2. JH Kerr capacity: 267 MW
- 0

JH Kerr -- Projected Lake Level

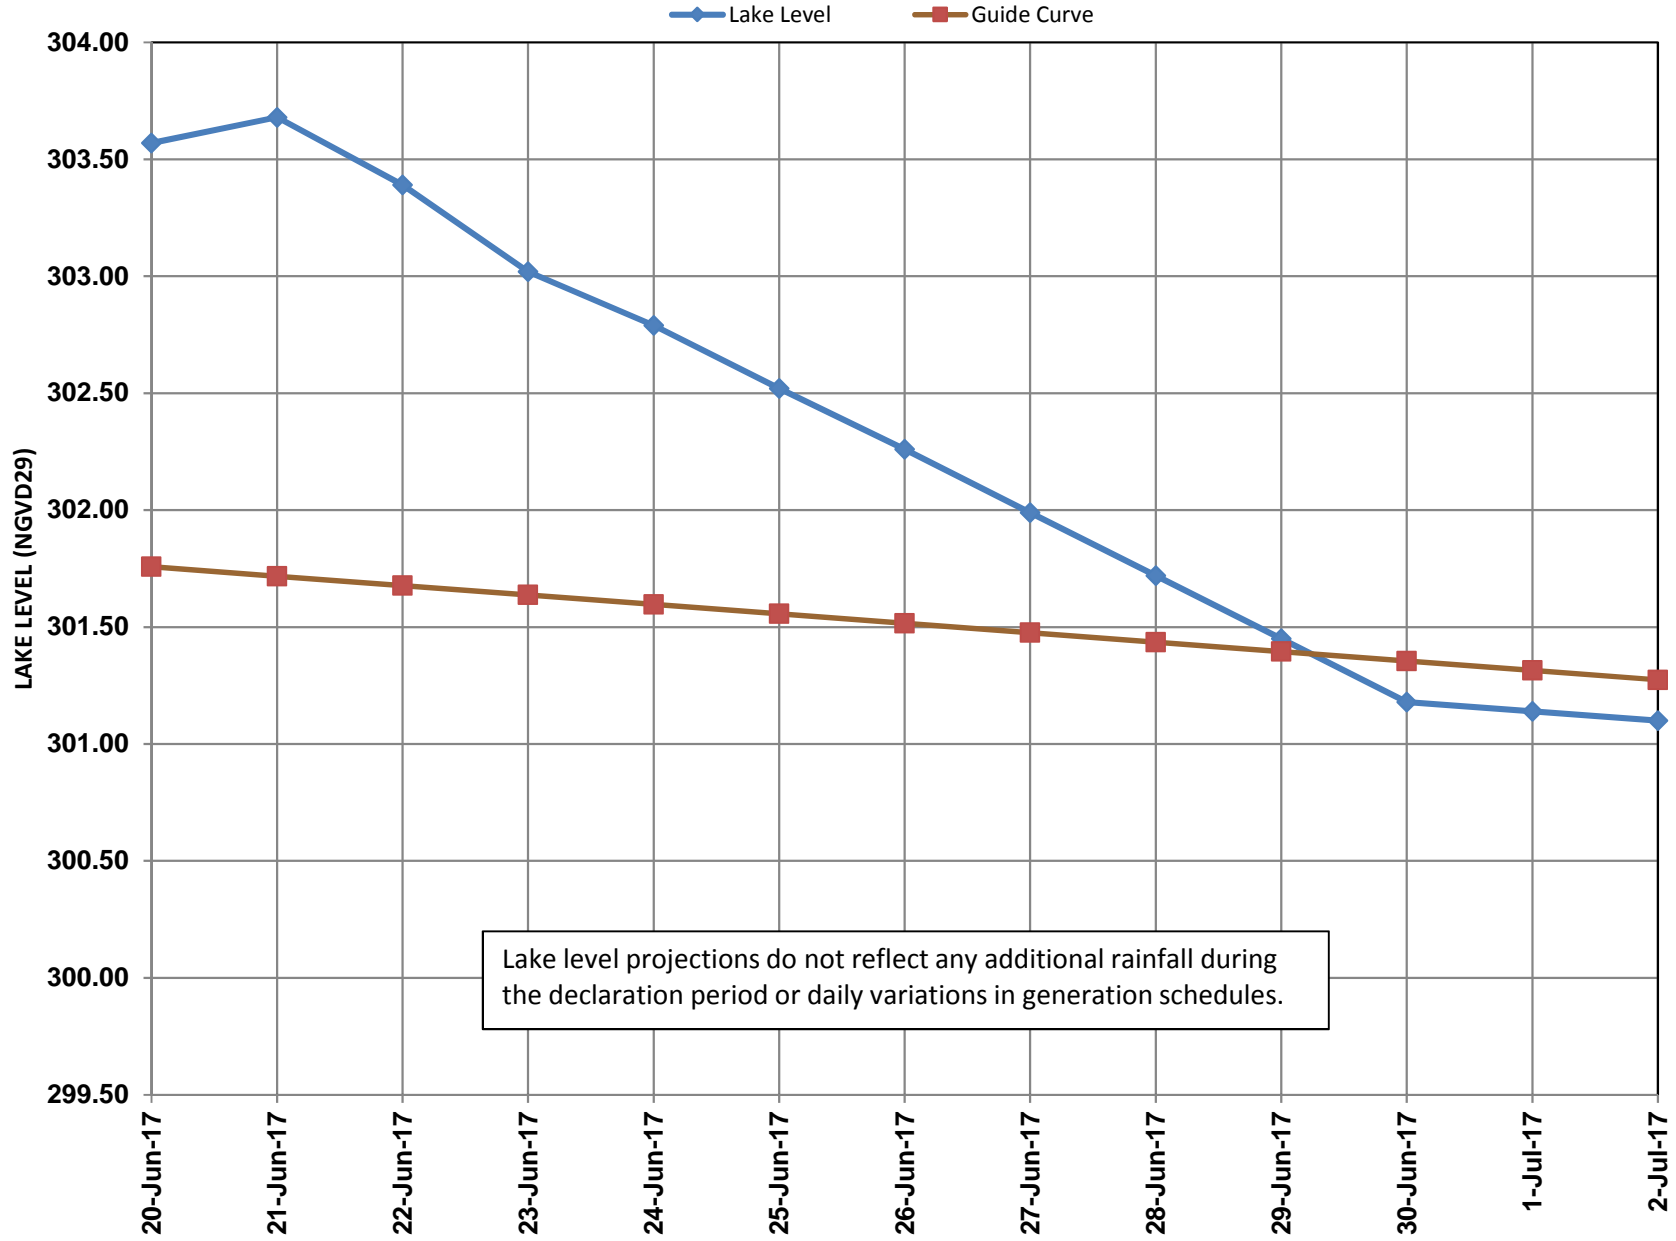

Philpott -- Projected Lake Level

